


S0068-U-BT

WITH DANFOSS IBC

ELECTRICAL SCHEMATIC 120 VOLT

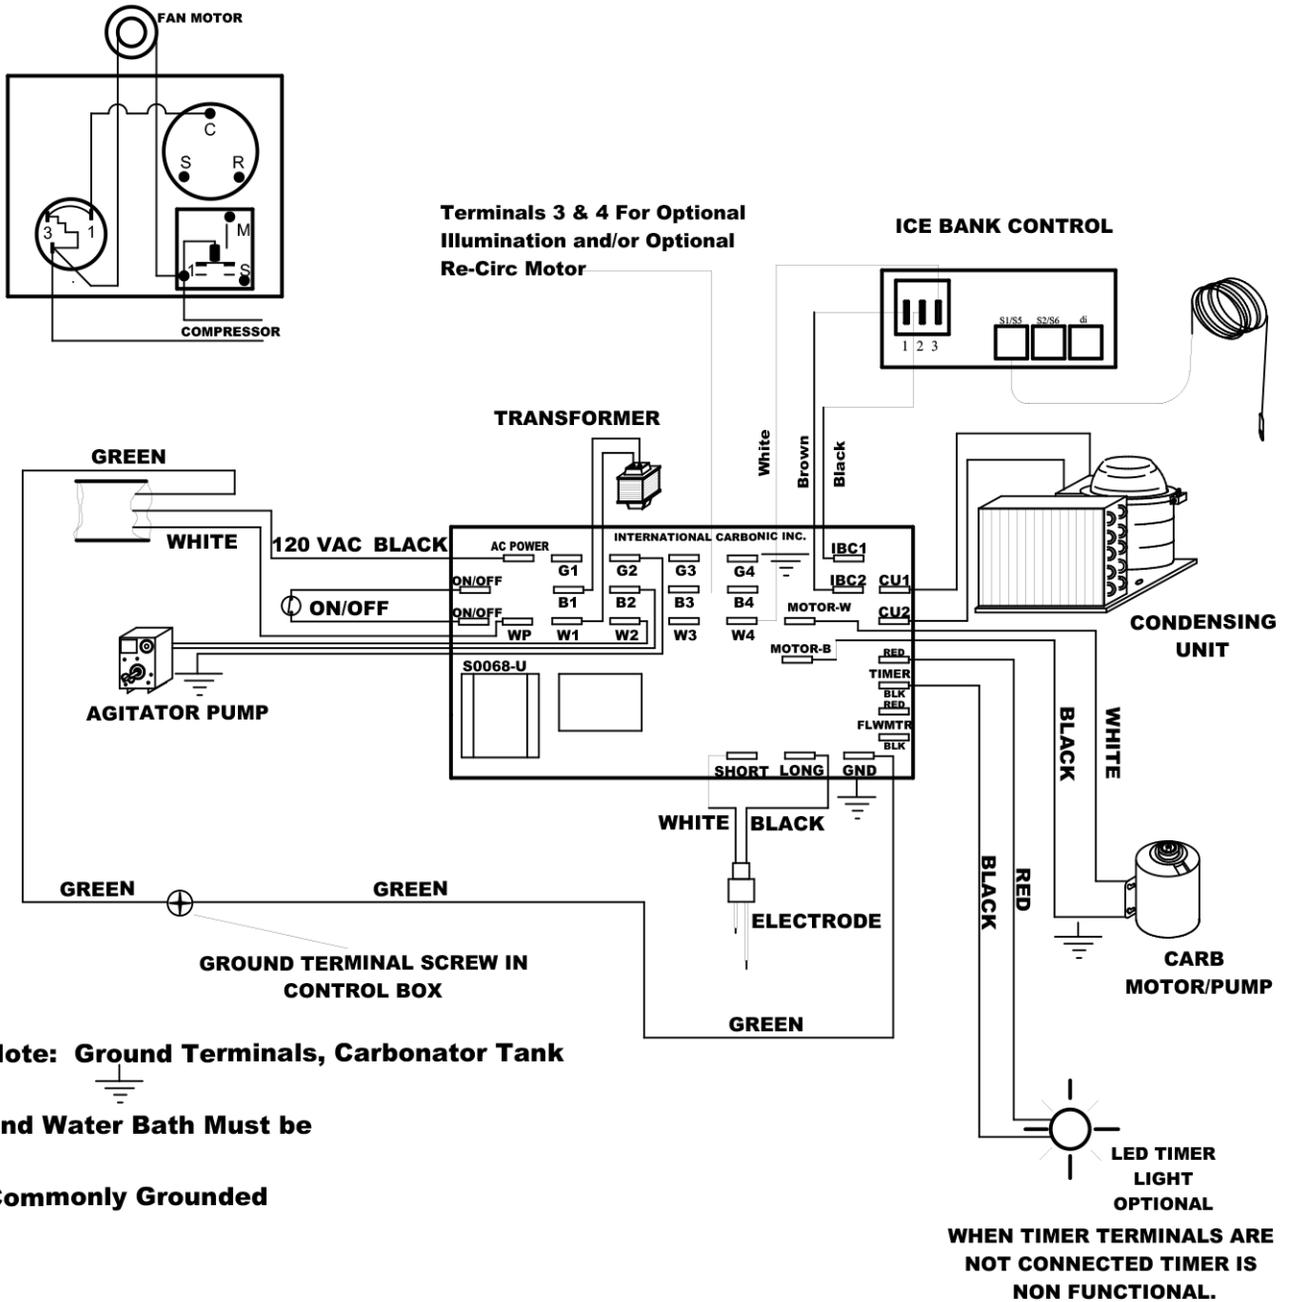

Note: Ground Terminals, Carbonator Tank and Water Bath Must be Commonly Grounded

NOTE: IF USING EXTRA 120V. ACCESSORIES SUCH AS RECIRCULATING MOTOR, ILLUMINATION ETC., MAKE CONNECTIONS AT TERMINAL B3, B4 FOR POWER/BLACK LEG. TERMINALS W3, W4 FOR NEUTRAL/WHITE LEG AND GROUND AT TERMINAL G3, G4.